



Record and Analyze Power Supply Problems Simultaneously with a Single Unit
The New World Standard for Power Quality Analysis

Never Miss the Moment

- Detect power supply problems and perform onsite troubleshooting
- Do preventive maintenance to avert accidents by managing the power quality

CAT IV-600V Safety Standard

- Meets the CAT IV safety rating required to check an incoming power line
- Safe enough to measure up to 6,000Vpeak of transient overvoltage

Easy Setup Function with PRESETS

- Just select the measurement course, wiring, and clamps
- Automatic one-step setup based on measurement conditions

Compliant with International Standards

- International power quality measurement standard IEC 61000-4-30 Edition 2 Class A
- High precision with a basic voltage measurement accuracy of 0.1%

AC FLEXIBLE CURRENT SENSOR

Introducing 2 new variations with a thinner cable!



Easy to loop around, even in confined spaces



One Single Unit Can Solve All Your Power Supply Problems



The number of power supply problems is increasing as power systems are becoming more and more complicated - all due to the rising use of power electronics devices plus a growing installed base of large systems and distributed power supplies. The quickest way to approach these problems is to understand the situation quickly and accurately. The PW3198 Power Quality Analyzer is ready to effectively solve your power supply problems.

Troubleshooting

- ✓ Understand the actual power situation at the site where the problem is occurring (e.g., the equipment malfunction, failure, reset, overheating, or burning damage).
- ✓ Ideal for troubleshooting solar and wind power generation systems, EV charge stations, smart grids, tooling machines, OA equipment (e.g., computers, printers, and UPS), medical equipment, server rooms, and electrical equipment (e.g., transformers and phase-advancing capacitors).

Field Survey and Preventive Maintenance

- ✓ Perform long-term measurements of the power quality and study problems that are difficult to detect or that occur intermittently.
- ✓ Maintain electrical equipment and check the operation of solar and wind power generation systems.
- ✓ Manage the parameters with a control set point, such as a voltage fluctuation, flicker, and harmonic voltage.

Power (Load) Survey

- ✓ Study the power consumption and confirm system capacity before adding load.

Advanced Features for Safe, Simple, and Accurate Measurements

1 International Standard IEC61000-4-30 Edition 2 Class A

Class A is defined in the international standard IEC61000-4-30, which specifies compatibility with power quality parameters, accuracy, and standards to enable comparison and discussion of the measurement results of different measuring instruments.

The PW3198 is compliant with IEC61000-4-30 Edition 2 Class A standard. The instrument can perform measurements in accordance with the standard, including continuous gapless calculation, methods to detect events such as dip, swell, and instantaneous power failure, and time synchronization using the optional GPS box.




2 CAT IV-600V Safety

The PW3198 is compliant with the measurement category CAT IV - 600V and can also safely test the incoming lines for both single-phase and three-phase power supplies.




3 Easy to set up - Just select the measurement course and the PW3198 will do the rest

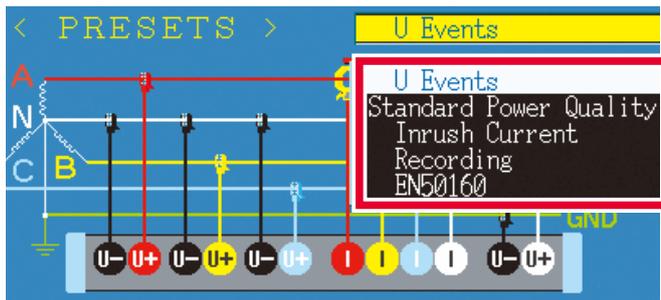


Simply choose the course based on the measurement objective and the necessary configurations will be set automatically.

U Events	Record voltage and frequency and detect errors simultaneously.
Standard Power Quality	Record voltage, current, frequency, and harmonic, and detect errors simultaneously.
Inrush current	Measure the inrush current.
Recording	Record only the TIME PLOT Data but do not detect errors.
EN50160	Perform measurements in accordance with EN50160.

4 Highly Accurate, Broadband, Wide Dynamic Range Makes for Reliable Measurements

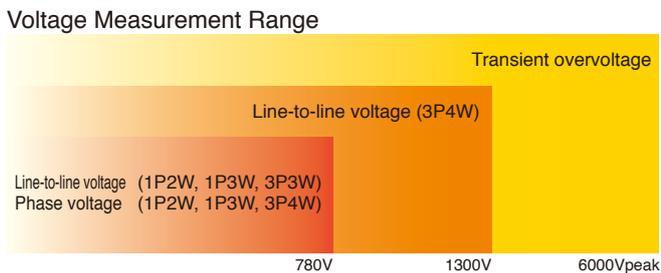

Both low and high voltages can be measured in a single range.

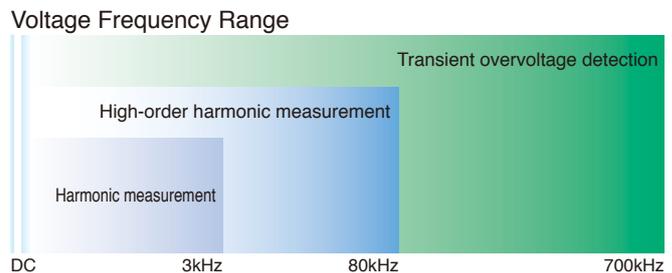


Wide range from DC voltage to 700 kHz

Basic Measurement Accuracy (50/60 Hz)

Voltage	±0.1% of nominal voltage
Current	±0.2% rdg., ±0.1% f.s. + Clamp-on sensor accuracy
Power	±0.2% rdg., ±0.1% f.s. + Clamp-on sensor accuracy

World's highest level of basic measurement accuracy. Extremely accurate voltage measurement without the need to switch ranges.


Transient Overvoltage

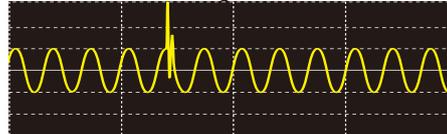

Waveform example

Transient overvoltage can also be measured in a range between the maximum 6,000 V and minimum 0.5 μs (2 MS/s).

High-order Harmonic

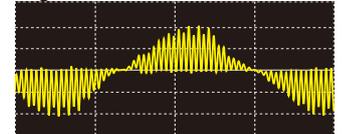

Waveform example

The PW3198 is the first power quality analyzer that can measure the high-order harmonic component of up to 80 kHz.


PW3198 Never Misses the Moment a Power Supply Failure Occurs

The PW3198 can measure all waveforms of power, harmonic, and error events simultaneously. When a problem occurs with the equipment or system on your site, the PW3198 will help you detect the cause of the problem early and solve it quickly. You can depend on the PW3198 to monitor all aspects of your power supplies.

Measure All Parameters at the Same Time


Acquire the Information You Need Quickly by Switching Pages (RMS Value)

Just connect to the measurement line, and the PW3198 will simultaneously measure all parameters, such as power and harmonic. You can then switch pages to view the needed information immediately.

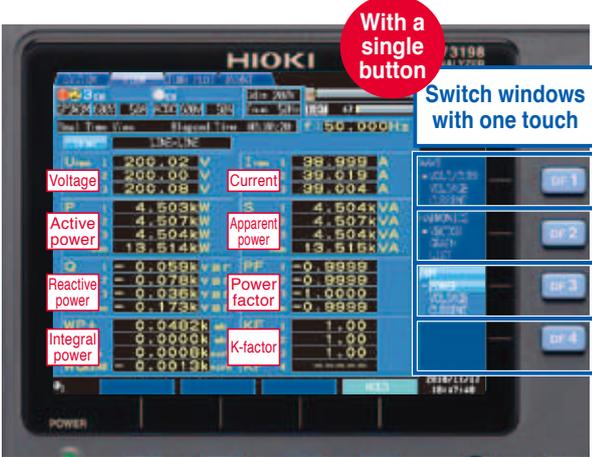



DMM Display

Display parameters such as voltage, current, power, power factor, and integral power in a single window.



Waveform Display

Display the voltage and current waveforms on channels 1 to 4 one above the other in a single window.





4-channel Waveform Display

Display the voltage and current waveforms on channels 1 to 4 individually.



Vector Display

Display the measured value and vector of the voltage and current of each order harmonic.




Harmonic Bar Graph Display

Display the RMS value and phase angle of harmonics from the 0th order to the 50th either in a graph or as numerical values.


Reliably Detect Power Supply Failures (Event)

To detect power supply failures, measurement does not need to be performed multiple times under different conditions. The PW3198 can always monitor and reliably detect all power supply failures for which detection is enabled.

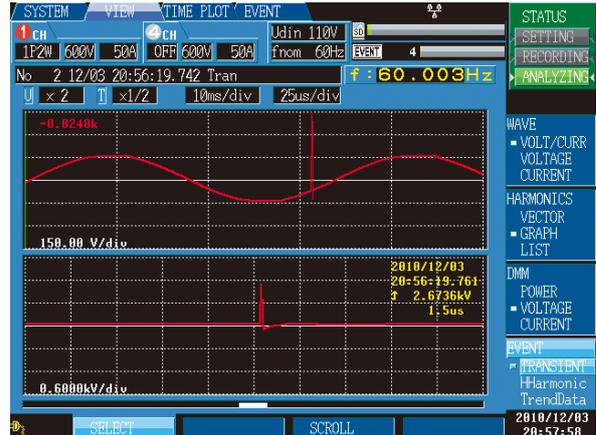


Transient Overvoltage (Impulse)

A transient overvoltage is generated by a lightning strike or a contact fault or closed contact of a circuit breaker and relay, and often causes a steep voltage change and a high voltage peak.




Voltage Dip (Voltage Drop)

Voltage dips for a short time as a result of large inrush current generated in the load by, for example, a starting motor.




Voltage Swell (Voltage Rise)

A voltage swell is generated by a lightning strike or a heavily loaded power line being opened or closed, causing the voltage to rise instantaneously.




Interruption

The power supply stops instantaneously or for a short or long time because electrical power transmission is stopped as a result of a lightning strike, or because the circuit breaker is tripped by a power supply short circuit.




Inrush Current

A large current flows instantaneously at the moment electrical equipment, a motor, or similar devices are powered on.




Frequency Fluctuations

An excessive increase or decrease of the load causes the operation of a generator to become unstable, resulting in frequency fluctuations.




High-order Harmonic

Voltage and current waveforms are distorted by noise components generated by a semiconductor control device or the like installed in the power supply of electronic equipment.



Harmonic

Harmonic is generated by a semiconductor control device installed in the power supply of equipment, causing distortion of voltage and current waveforms.



Unbalance

An increase or decrease in the load connected to each phase of the three-phase power supply or an unbalanced operation of equipment and devices causes the load of a particular phase to become heavy so that voltage and current waveforms are distorted, voltage drops, or negative phase sequence voltage is generated.

Simultaneous Recording of **TIME PLOT Data** and **Event Waveforms**

TIME PLOT Data


TIME PLOT Recording of All Parameters

The PW3198 can simultaneously record 8,000 or more parameters, such as voltage, current, power, power factor, frequency, integral power, harmonic, and flicker, at the specified recording interval. The PW3198 never fails to capture the peak because it performs calculations continuously and records the maximum, minimum, and average values within the recording interval.




Trend Recording (TIME PLOT Recording)


EVENT Switch windows with one touch



Harmonic Recording



Flicker and ΔV10 Recording

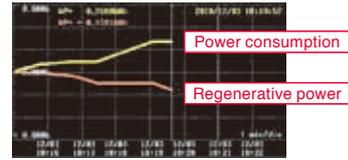


Integral Power Recording

Event Waveforms


Capture up to 55,000 Instantaneous Waveforms of Power Supply Failures

The PW3198 can record up to 1,000 instantaneous waveforms of power supply failures (up to 55,000 when repeat recording is set to ON) while performing TIME PLOT recording.

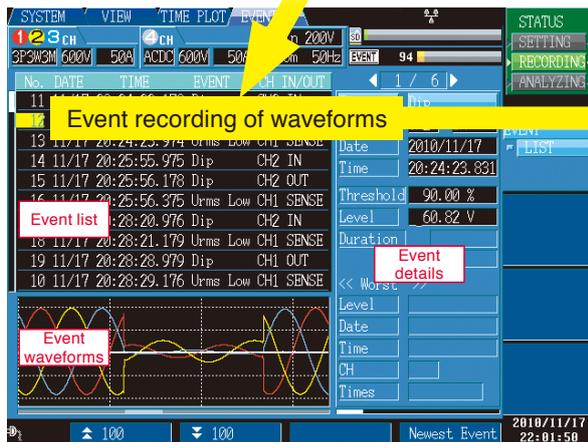


Event List

This list records instantaneous waveforms of power supply failures (events), such as a voltage drop or inrush current, along with the time or other information. Events are always monitored, regardless of the recording interval of the TIME PLOT recording.

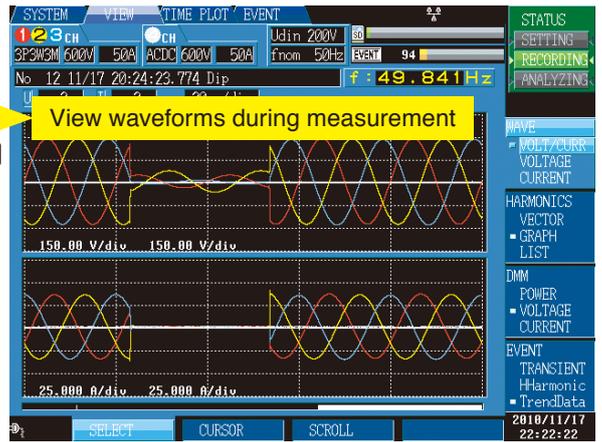

Event Waveform

The PW3198 lets you view the instantaneous waveform (200 ms) of a power supply failure in the window.



RMS value changes over 30 seconds
When a voltage drop or inrush current occurs, RMS value changes are recorded over 30 seconds simultaneously. This function can also be used to check the voltage drop caused by inrush current generated by the start of the motor.




Analyze Recorded Data with a PC Using Application Software 9624-50 PQA-HiVIEW PRO

Use Model 9624-50 PQA-HiVIEW PRO (version 2.00 or later) with a PC to analyze the data collected by the PW3198.

Viewer Function

Display and analyze the data recorded by the PW3198 POWER QUALITY ANALYZER.

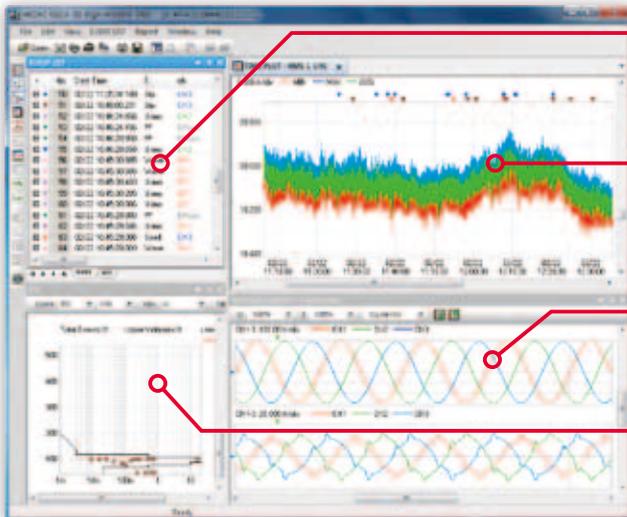

Event List Window

Display a list of power supply failures (events) that occurred.

TIME PLOT Window


Display the TIME PLOT (recorded trend) data as well as changes in the voltage/current RMS values, harmonic, and many other parameters.

Event Waveform Window

Display the waveform of an event that occurred, plus the vector, harmonic, DMM, and instantaneous harmonic values.

ITIC Curve Display Window

Analyze the ITIC (CBEMA) curve (tolerance curve) used in the power quality standards in the United States.




Status Window



Transient Waveform Window



Inrush Current Event Graph Window

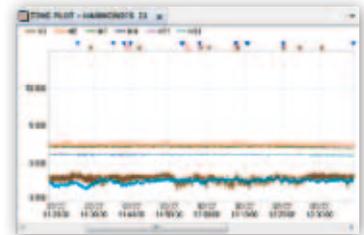


Harmonics TIME PLOT Window

Report Creation Function

Automatically and effortlessly create rich reports for compliance and record management.

Report output items: Voltage/current RMS value fluctuation graph, harmonic fluctuation graph, inter-harmonics fluctuation graph, flicker graph, integral power graph, demand graph, total harmonic voltage/current distortion rate list, EN50160 window (Overview, Harmonic, Measurement Results Category), worst case, transient waveform, maximum/minimum value list, all event waveforms/detailed list, and setup list

Print Examples



RMS Value Voltage Fluctuations



All Event Detailed List



TIME PLOT Recording of Parameters



EN50160

Other Functions

CSV Conversion of Measurement Data

Convert data in the range specified in the TIME PLOT window into CSV format and then save for further processing. The 9624-50 can also convert event waveforms into CSV format. Open CSV data using any commercially available spreadsheet software for advanced data management and analysis.

Even Analyze Data Recorded with Models 3196 and 3197 PQAs

Data recorded with the HIOKI 3196 and 3197 Power Quality Analyzers can also be analyzed.



Download Measurement Data via USB/LAN

Data in the SD memory card inserted in the PW3198 can be downloaded to a PC via USB or LAN.

EN50160 Display Function

EN50160 is a power quality standard for the EU. In this mode, evaluate and analyze power quality in accordance with the standard. You can display the Overview, Harmonic, and Measurement Results Category windows.

9624-50 Specifications

Delivery media	CD-R
Operating environment	AT-compatible PC
OS	Windows10, Windows8, Windows7
Memory	512 MB or more

Useful Functions for a Wide Variety of Applications

Large Capacity Recording with SD memory card

Data is recorded to a large capacity SD memory card. The data can be transferred to a PC and analyzed using dedicated application software. If your PC is not equipped with an SD memory card slot, simply connect a USB cable between the PW3198 and the PC. The PC will then recognize the SD memory card as removable media.



Repeat record	Recording period
OFF	Max. 35 days Reference value: ALL DATA (all items recorded), repeat recording OFF, and TIME PLOT interval 1 minute or longer)
ON	Max. 55 weeks (about 1 year) Reference value: ALL DATA (all items recorded), repeat recording ON (1 week x 55 times), and TIME PLOT interval 10 minutes or longer)

Remote Measurement Using HTTP Server Function


You can use any Internet browser to remotely operate the PW3198, plus download the data stored in the SD memory card using dedicated software (LAN access required).



Conduct off-site remote control with a tablet PC using a wireless LAN router

GPS Time Synchronization

The PW9005 GPS BOX lets you synchronize the clock on the PW3198 to the UTC standard time. Eliminate time differences between multiple PQAs and correctly analyze measurement data taken by several instruments.

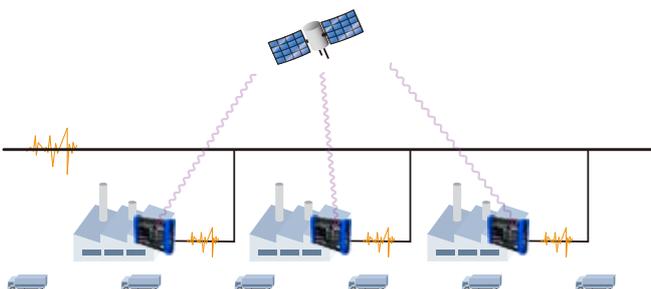

Simultaneously Measure Three-phase Lines and Grounding Wire

Apart from the main measurement line, you can also measure the AC/DC voltage on another line using Channel 4.



Yes! Simultaneously!

- Measure the primary and secondary sides of UPS
- Two-line voltage analysis
- Measure three-phase lines and grounding wire
- Measure neutral lines to detect short circuits
- Measure the input and output of a DC-AC converter for solar power generation




An Assortment of Clamp-on Sensors Covers a Broad Range of Measurements

In addition to current sensors for measuring 100A AC, 500A AC, 1000A AC and 5000A AC rated currents, a 5A AC sensor is also available. In addition, HIOKI's CLAMP ON LEAK SENSORS enable you to accurately measure for leakage current down to the mA level, while the new CT7700 AC/DC AUTO-ZERO CURRENT SENSOR further widen applications by supporting DC current testing.



Backup and Recovery from Power Failure

The PW3198 uses the new large capacity BATTERY PACK Z1003, enabling continuous measurement for three hours even if a power failure occurs. In addition, a power failure processing function restarts measurement automatically even if the power is cut off completely during measurement.



Other Measurement Applications

- Flicker measurement**
Measure flicker in conformance with IEC 61000-4-15 Ed2.
- Phase voltage check for Δ connection**
Use the Δ-Y and Y-Δ conversion function to measure phase voltage using a virtual neutral point.
- 400 Hz line measurement**
Measure at a power line frequency of 50/60 Hz as well as 400 Hz.

Power Quality Survey Applications


The power supply of the office equipment sometimes shuts down

Survey Objective

The power supply of a printer at the office shuts down even though it is not operated. Equipment other than the printer can also sometimes perform a reset unexpectedly.

Measurement Method

Setup is very easy. Just install the PW3198 on the site, and measure the voltage, current, and power. To troubleshoot, just select the clamp-on sensor and wiring, and then select the "U Events" course.

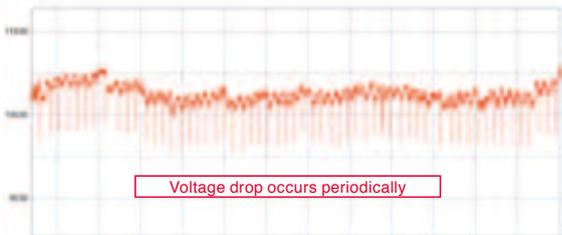

Voltage Fluctuation Graph

Analysis Report

No failure occurred during the measurement period, but a periodic voltage drop was confirmed. The voltage drop may have been caused by the periodic start and operation of the electrical equipment connected to the power supply line. Equipment, such as a laser printer, copier, and electrical heater, may start themselves periodically due to residual heat. An instantaneous voltage drop is likely to have been caused by inrush current from equipment that consumes a large amount of power.



Medical equipment malfunctions

Survey Objective

Replacing the equipment with a new one by the service provider did not improve the malfunction. A survey of the power supply was required to clarify the cause.

Measurement Method

Select the "U Events" course in the PW3198 in the same way as with the office equipment example.

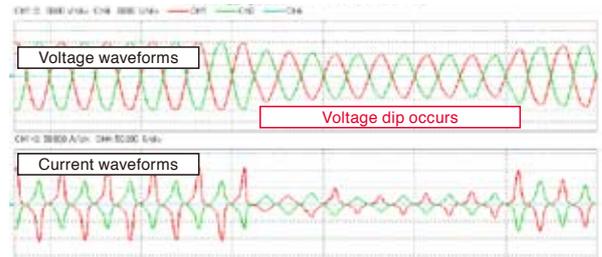

Voltage and Current Waveforms at the Time Voltage Dip Occurs

Analysis Report

It was determined that a voltage dip (voltage drop) occurred and impacted the operation of the equipment. If a voltage dip occurs every day on a regular basis, the probable cause is the start of a large air-conditioning unit, pump, heater, or similar equipment.

Surveying a Solar Power Generation System

Survey Objective



- Maintain a solar power generation system and check its operation (verify the power quality)
- Troubleshoot (impact on the peripheral equipment, operation shutdown, etc.)

Measurement Method


Set up the PW3198 on the site and measure the voltage, current, and power. To survey the power quality, select the "Standard power quality measurement" course in the PRESETS menu. To measure the DC voltage, connect channel 4 to the primary side of the solar panel.



Connection Example

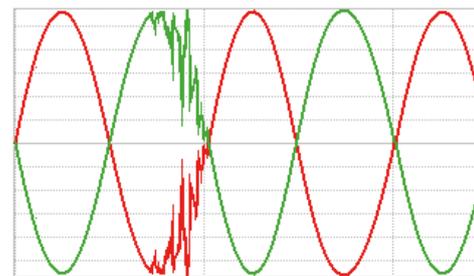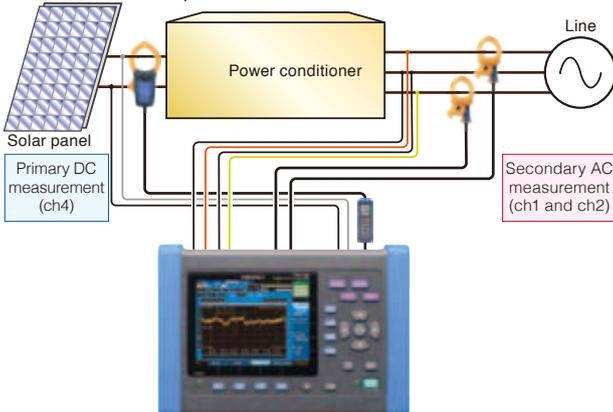

Example of Voltage Waveforms at the Time of Line Switching

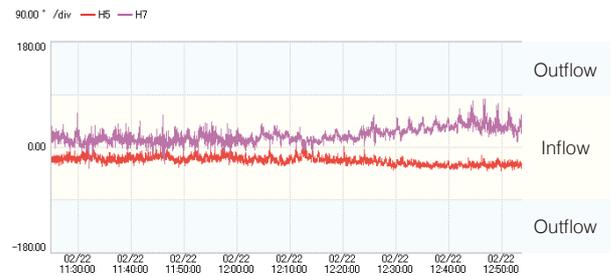

Example of Determining Inflow or Outflow (Inflow of 5th and 7th Order Harmonic)

Analysis Report

- All parameters can be recorded simultaneously with a single measurement.
- Identify changes in the output voltage of the power conditioner
 - Presence or absence of the occurrence of a transient overvoltage
 - Frequency fluctuation important for system interconnection
 - Identify changes in the harmonic voltage and current included in the output
 - Power (AC), integral power (AC), etc.

PW3198 Specifications (Accuracy guaranteed for 1 year, Post-adjustment accuracy guaranteed for 1 year)

Measurement items

Voltage measurement items (TIME PLOT Recording)	RMS voltage Frequency DC voltage Harmonic voltage (0 to 50th order) Inter-harmonic voltage (0.5 to 49.5th) Total harmonic voltage distortion factor	Waveform voltage peak Frequency (1 cycle, 10-sec) IEC Flicker (Pst, Plt) Harmonic voltage phase angle (0 to 50th) High order harmonic voltage component Voltage Unbalance factor (Zero-phase /Negative-phase)
Current measurement items (TIME PLOT Recording)	RMS current Waveform current peak Harmonic current phase angle (0 to 50th) Harmonic current (0 to 50th) Inter-harmonic current (0.5 to 49.5th)	High order harmonic current component Total harmonic current distortion factor Current Unbalance factor (Zero-phase /Negative-phase) K factor DC current (when using compatible sensor)
Power measurement items (TIME PLOT Recording)	Active power Reactive power Apparent power Power factor	Harmonic power (0 to 50th) Harmonic voltage-current phase angle (0 to 50th) Active energy Reactive energy
EVENT measurement items (EVENT Recording)	Transient overvoltage Voltage swell Voltage dip Interruption Inrush current	Frequency fluctuations Voltage waveform comparison Timer External events
Event detection using upper and lower thresholds available with other voltage, current and power measurement parameters (excluding Integrated power, Unbalance, Inter-harmonic, Harmonic phase angle, IEC Flicker)		

Input specifications

Measurement circuits	Single-phase 2-wire (1P2W), single-phase 3-wire (1P3W), three-phase 3-wire (3P3W2M, 3P3W3M) or three-phase 4-wire(3P4W, 3P4W2.5E) plus one extra input channel (must be synchronized to reference channel during AC/DC measurement)
Fundamental frequency of measurement circuit	50Hz, 60Hz, 400Hz
Input channels	Voltage : 4 channels (U1 to U4), Current : 4 channels (I1 to I4)
Input methods	Voltage : Isolated and differential inputs (channels not isolated between U1, U2 and U3; channels isolated between U1 to U3 and U4) Current : Insulated clamp-on sensors (voltage output)
Input resistance	Voltage : 4MΩ ±80kΩ (differential inputs) Current : 100kΩ ±10kΩ
Compatible clamp sensors	Units with f.s.=0.5V output at rated current input (f.s.=0.5V recommended) Units with rate of 0.1mV/A, 1mV/A, 10mV/A, or 100mV/A

Measurement ranges
(Ch1 to Ch4 can be configured the same way; only CH4 can be configured separately)

Voltage measurement ranges

Voltage measurement items	Ranges
Voltage measurement	600.00V
Transient measurement	6.0000kV peak

PW3198 current ranges

Current sensor	Current range setting (A)
9660	100.00 / 50.000
9661	500.00 / 50.000
CT9667-01 (500A)	500.00 / 50.000
CT9667-01 (5kA)	5.0000k / 500.00
CT9667-02 (500A)	500.00 / 50.000
CT9667-02 (5kA)	5.0000k / 500.00
CT9667-03 (500A)	500.00 / 50.000
CT9667-03 (5kA)	5.0000k / 500.00
9669	1.0000k / 100.00
9694	50.000 / 5.0000
9695-02	50.000 / 5.0000
9695-03	100.00 / 10.000

Current sensor	Current range setting(A)
CT7731 (60A)	50.000 / 5.0000
CT7731 (100A)	500.00 / 50.000
CT7736 (60A)	50.000 / 5.0000
CT7736 (600A)	500.00 / 50.000
CT7742 (600A)	500.00 / 50.000
CT7742 (2kA)	5.0000k / 500.00
9657-10	5.0000 / 500.00m
9675	5.0000 / 500.00m

PW3198 Power ranges

(automatically configured based on current range)

Current range	Power range (W / VA / var)
5.0000 kA	3.0000M
1.0000 kA	600.00k
500.00 A	300.00k
100.00 A	60.000k

Current range	Power range (W / VA / var)
50.000 A	30.000k
10.000 A	6.0000k
5.0000 A	3.0000k

Basic specifications

Maximum recording period	55 weeks (with repeated recording set to [1 Week], 55 iterations) 55 days (with repeated recording set to [1 Day], 55 iterations) 35 days (with repeated recording set to [OFF])
Maximum recordable events	55,000 events (with repeated recording on) 1000 events (with repeated recording off)
TIME PLOT data settings	TIME PLOT interval (MAX/MIN/AVG within each interval recorded) 1s, 3s, 15s, 30s, 1m, 5m, 10m, 15m, 30m, 1h, 2h, 150 cycle (at 50Hz), 180 cycle (at 60Hz), 1200 cycle (at 400Hz) Screen copy interval (screen shot at each interval saved to SD memory card) OFF, 5m, 10m, 30m, 1h, 2h Timer EVENT interval (200ms instantaneous waveform saved at each interval) OFF, 1m, 5m, 10m, 30m, 1h, 2h Time start and End OFF: Start recording manually ON: Start time and End time can be configured Repeated recording settings (maximum 55 iterations) OFF: Recording is not repeated 1Week: 55 weeks maximum in 1week segmentations 1Day: 55 days maximum in 1day segmentations Repeat time Daily Start time and End time can be configured when Repeated recording set to 1Day.
Recording items settings	Power (Small): Recording basic parameters P&Harm (Normal): Recording basic parameters and harmonics All Data (Full): Recording P&Harm items and inter-harmonics
Memory data capacity	SD memory card/ SDHC memory card 2G to 32GB Contact your HIOKI representative for special order larger capacity cards that offer the HIOKI guarantee.

PRESETS function	U Events : Record and monitor voltage elements and frequency, plus detect events Standard Power Quality : Record and monitor voltage and current elements, frequency, and harmonics, plus detect events Inrush Current : Measure inrush current (basic voltage measurement required) Recording : Record only trend data, no event detection EN50160 : Measure according to EN50160 standards
Real-Time Clock function	Auto-calendar, leap-year correcting 24-hour clock
Display Language	English, Simplified Chinese, Japanese
Real-time clock accuracy	±0.3 s per day (with instrument on, 23°C±5°C (73°F±9°F))
Power supply	AC ADAPTER Z1002 (12 VDC, Rated power supply 100VAC to 240VAC, 1.7Amax, 50/60Hz) BATTERY PACK Z1003 (Ni-MH 7.2VDC 4500 mAh)
Maximum rated power	15VA (when not charging, except AC adapter), 35VA (when charging, except AC adapter)
Continuous battery operation time	Approx. 180 min. [②3°C (⑦3.4°F), when using BATTERY PACK Z1003]
Recharge function	BATTERY PACK Z1003 charges regardless of whether the instrument is on or off; charge time: max. 5 hr. 30 min. ②3°C (⑦3.4°F)
Power outage processing	In the event of a power outage during recording, instrument resumes recording once the power is back on (integral power starts from 0).
Power supply quality measurement method	IEC61000-4-30 Ed.2 :2008, IEEE1159 EN50160 (using Model PQA-HiVIEW PRO 9624-50)
Dimensions	Approx. 300 W× 211 H × 68 D mm (11.81" W × 8.31" H × 2.68" D) (excluding protrusions)
Mass	Approx. 2.6 kg (91.7 oz.) (including battery pack)
Accessories	Instruction manual, Measurement guide, VOLTAGE CORD L1000 (8 cords, approx. 3 m each: 1 each red, yellow, blue, and gray plus 4 black; 8 alligator clips: 1 each red, yellow, blue, and gray plus 4 black), Spiral Tube, Input Cable Labels (for identifying channel of voltage cords and clamp-on sensors), AC ADAPTER Z1002 , Strap, USB cable (1 m length), BATTERY PACK Z1003 , SD MEMORY CARD (2GB) Z4001

Display specifications

Display	6.5-inch TFT color LCD (640 × 480 dots)
---------	---

External Interface Specifications

SD memory card Interface	Saving of binary data, Saving and Loading setting files, Saving and Loading screen copies Slot : SD standard compliant Compatible card : SD memory card/ SDHC memory card (Use only HIOKI-approved SD memory cards) Supported memory capacity : SD memory card: Up to 2GB, SDHC memory card: Up to 32GB Media full processing : Saving of data to SD memory card is stopped												
RS-232C Interface	Measurement and control using GPS-synchronized time (connecting GPS BOX) Connector : D-sub9pin Connection destination : GPS box (cannot be connected to computer)												
LAN Interface	1. HTTP server function (compatible software: Internet Explorer Ver.6 or later, Remote operation application function, measurement start and stop control functions, system configuration function, event list function (capable of displaying event waveforms, event vectors, and event harmonic bar graphs)) 2. Downloading of data from the SD memory card using the 9624-50 PQA-HiView Pro Connector : RJ-45 Transmission method : 10BASE-T,100BASE-TX												
USB2.0 Interface	1. Recognizes the SD memory card as a removable disk when connected to a computer. <i>The instrument cannot be connected during recording (including standby operation) or analysis.</i> 2. Download data from the SD memory card using the 9624-50 PQA-HiView Pro <i>The instrument cannot be connected during recording (including standby operation) or analysis.</i> Connector : Series B receptacle Connection destination : Computer [Windows10 (32bit/ 64bit), Windows8 (32bit/ 64bit), Windows7 (32bit/ 64bit)]												
External control interface	Connector : 4-pin screwless terminal block External event input : External event input at TTL low level (at falling edge of 1.0 V or less and when shorted) between GND terminal and EVENT IN terminal Min. pulse width: 30 ms; rated voltage: -0.5 V to +6.0 V External event output : <table border="1" data-bbox="630 1265 1412 1444"> <thead> <tr> <th>External event output item setting</th> <th>Operation</th> <th>Pulse width</th> </tr> </thead> <tbody> <tr> <td>Short pulse output</td> <td>TTL low output at event generation between [GND] terminal and [EVENT OUT] terminal</td> <td>Low level for 10 ms or more</td> </tr> <tr> <td>Long pulse output</td> <td>TTL low output at event generation between [GND] terminal and [EVENT OUT] terminal (No external event output at START event)</td> <td>Low level for approx. 2.5 s</td> </tr> <tr> <td>ΔV10 alarm</td> <td>TTL low output at ΔV10 alarm between [GND] terminal and [EVENT OUT] terminal</td> <td>Low level while alarm occurring ; reverts to high at data reset</td> </tr> </tbody> </table>	External event output item setting	Operation	Pulse width	Short pulse output	TTL low output at event generation between [GND] terminal and [EVENT OUT] terminal	Low level for 10 ms or more	Long pulse output	TTL low output at event generation between [GND] terminal and [EVENT OUT] terminal (No external event output at START event)	Low level for approx. 2.5 s	ΔV10 alarm	TTL low output at ΔV10 alarm between [GND] terminal and [EVENT OUT] terminal	Low level while alarm occurring ; reverts to high at data reset
External event output item setting	Operation	Pulse width											
Short pulse output	TTL low output at event generation between [GND] terminal and [EVENT OUT] terminal	Low level for 10 ms or more											
Long pulse output	TTL low output at event generation between [GND] terminal and [EVENT OUT] terminal (No external event output at START event)	Low level for approx. 2.5 s											
ΔV10 alarm	TTL low output at ΔV10 alarm between [GND] terminal and [EVENT OUT] terminal	Low level while alarm occurring ; reverts to high at data reset											

Environment and safety specifications

Operating environment	Indoors, altitude up to 3000 m (measurement category is lowered to 600 V CAT III when above 2000m), Pollution degree 2
Storage temperature and humidity	-20 to 50°C (-4 to 122°F) 80% RH or less (non-condensating) (If the instrument will not be used for an extended period of time, remove the battery pack and store in a cool location [from -20 to 30°C (-4 to 86°F)].)
Operating temperature and humidity	0 to 50°C (32 to 122°F) 80% RH or less (non-condensating)
Dust and water resistance	IP30 (EN60529)
Maximum input voltage	Voltage input section 1000 VAC, DC±600 V, max. peak voltage ±6000 Vpeak Current input section 3VAC, DC±4.24V
Maximum rated voltage to earth	Voltage input terminal 600 V (Measurement Categories IV, anticipated transient overvoltage 8000 V)
Dielectric strength	6.88 kVrms (@50/60 Hz, 1 mA sense current): Between voltage measurement terminals (U1 to U3) and voltage measurement terminals (U4) 4.30 kVrms (1 mA@50/60 Hz, 1 mA sense current): Between voltage input terminal (U1 to U3) and current input terminals/interfaces Between voltage (U4) and current measurement terminals, and interfaces
Applicable standards	Safety EN61010 EMC EN61326 Class A, EN61000-3-2, EN61000-3-3

Measurement Specifications

(For specifications when measuring 400Hz circuits, please inquire with your HIOKI distributor.)

TIME PLOT	: The MAX/MIN/AVG of each recording interval for each parameter are recorded.
EVENT	: When a power anomaly occurs, approx. 200ms instantaneous waveform is recorded.
TRANSIENT	: When a transient overvoltage is detected, the 2ms instantaneous waveforms before and after the occurrence (total 4ms) are recorded.
FLUCTUATION	: The RMS fluctuation 0.5s before and 29.5s after an event has occurred are recorded.
HIGH-ORDER HARM	: When a high order harmonic event occurs, the 40ms instantaneous waveform is recorded.

Transient overvoltage

TRANSIENT**EVENT**

Display items	For single transient incidents and continuous transient incidents Transient voltage value, Transient width For continuous transient incidents Transient period (Period from transient IN to transient OUT) Max. transient voltage value (Max. peak value during the period) Transient count during period
Measurement method	Detected from waveform obtained by eliminating the fundamental component (50/60/400 Hz) from the sampled waveform
Sampling frequency	2MHz
Measurement range, resolution	±6.0000kVpeak, 0.0001kV
Measurement bandwidth	5 kHz (-3dB) to 700 kHz (-3dB)
Min. detection width	0.5 μs
Measurement accuracy	±5.0% rdg.±1.0%f.s.

RMS voltage/ RMS current refreshed each half-cycle

TIME PLOT**EVENT**

Measurement method	RMS voltage refreshed each half-cycle : True RMS type, RMS voltage values are calculated using sample data for 1 waveform derived by overlapping the voltage waveform every half-cycle RMS current refreshed each half-cycle : RMS current is calculated using current waveform data sampled every half-cycle
Sampling frequency	200kHz
Measurement range, resolution	RMS voltage refreshed each half-cycle : 600.00V, 0.01V RMS current refreshed each half-cycle : Based on clamp-on sensor in use; see Input specifications
Measurement accuracy	RMS voltage refreshed each half-cycle : ±0.2% of nominal voltage (With 1.666% f.s. to 110% f.s. input and a nominal input voltage of at least 100 V) ±0.2%rdg.±0.08%f.s. (With input outside the range of 1.666% f.s. to 110% f.s. or a nominal input voltage of less than 100 V) RMS current refreshed each half-cycle : ±0.3% rdg.±0.5%f.s. + clamp-on sensor accuracy

Swell/ Dip/ Interruption

FLUCTUATION**EVENT**

Display item	Swell : Swell height, Swell duration Dip : Dip depth, Dip duration Interruption : Interruption depth, Interruption duration
Measurement method	Swell : A swell is detected when the RMS voltage refreshed each half-cycle exceeds the threshold in the positive direction Dip : A dip is detected when the RMS voltage refreshed each half-cycle exceeds the threshold in the negative direction Interruption : An interruption is detected when the RMS voltage refreshed each half-cycle exceeds the threshold in the negative direction
Range and accuracy	See RMS voltage refreshed each half-cycle

Inrush current

FLUCTUATION**EVENT**

Display item	Maximum current of RMS current refreshed each 1/2 cycle
Measurement method	Detected when the RMS current refreshed each 1/2 cycle exceeds the threshold in a positive direction
Range and accuracy	See RMS current refreshed each half-cycle

RMS voltage, RMS current

TIME PLOT**EVENT**

Display items	RMS voltage : RMS voltage for each channel and AVG (average) RMS voltage for multiple channels RMS current : RMS current for each channel and AVG (average) RMS current for multiple channels
Measurement method	AC+DC True RMS type (Current DC value: when using compatible sensor) RMS value calculated from 10 cycles (50 Hz) or 12 cycles (60 Hz)
Sampling frequency	200kHz
Measurement range, resolution	RMS voltage : 600.00V, 0.01V RMS current : Based on clamp-on sensor in use; see Input specifications
Measurement accuracy	RMS voltage : ±0.1% of nominal voltage (With 1.666% f.s. to 110% f.s. input and a nominal input voltage of at least 100 V) ±0.2%rdg.±0.08%f.s. (With input outside the range of 1.666% f.s. to 110% f.s. or a nominal input voltage of less than 100 V) RMS current : ±0.2% rdg.±0.1%f.s. + clamp-on sensor accuracy

Voltage waveform peak/ Current waveform peak

TIME PLOT**EVENT**

Display item	Positive peak value and negative peak value
Measurement method	Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz) maximum and minimum points sampled during approx. 200 ms aggregation
Sampling frequency	200kHz
Measurement range, resolution	Voltage waveform peak : ±1200.0 Vpeak, 0.1V Current waveform peak : The quadruple of RMS current measurement range (Based on clamp-on sensor in use; See Input specifications)

Voltage waveform comparison

EVENT

Display item	Event detection only
Measurement method	A judgment area is automatically generated from the previous 200 ms aggregation waveform, and events are generated based on a comparison with the judgment waveform. Waveform judgments are performed once for each 200 ms aggregation.
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)
No. of window points	4096 points synchronized with harmonic calculations

Frequency cycle

TIME PLOT**EVENT**

Measurement method	Calculated as the reciprocal of the accumulated whole-cycle time during one U1 (reference channel) cycle
Measurement range, resolution	70.000Hz, 0.001Hz
Measurement bandwidth	40.000 to 70.000Hz
Measurement accuracy	±0.200 Hz or less (for input from 10% f.s. to 110% f.s.)

Frequency

TIME PLOT**EVENT**

Measurement method	Calculated as the reciprocal of the accumulated whole-cycle time during approx. 200ms period of 10 or 12 U1 (reference channel) cycles
Measurement range, resolution	70.000Hz, 0.001Hz
Measurement bandwidth	40.000 to 70.000Hz
Measurement accuracy	±0.020 Hz or less

10-sec frequency

TIME PLOT

Measurement method	Calculated as the reciprocal of the accumulated whole-cycle time during the specified 10s period for U1 (reference channel) as per IEC61000-4-30
Measurement range, resolution	70.000Hz, 0.001Hz
Measurement bandwidth	40.000 to 70.000Hz
Measurement accuracy	±0.010 Hz or less

Voltage DC value (ch4 only)**TIME PLOT****EVENT**

Measurement method	Average value during approx. 20ms aggregation synchronized with the reference channel (CH4 only)
Sampling frequency	200kHz
Measurement range, resolution	600.00V, 0.01V
Measurement accuracy	±0.3%rdg. ±0.08%f.s.

Current DC value (ch4 only; when using compatible sensor)**TIME PLOT****EVENT**

Measurement method	Average value during approx. 200ms aggregation synchronized to reference channel (CH4 only)
Sampling frequency	200kHz
Measurement range, resolution	Based on clamp-on sensor in use (when using compatible sensor)
Measurement accuracy	±0.5% rdg.±0.5%f.s. + clamp-on sensor accuracy

Active power/ Apparent power/ Reactive power**TIME PLOT****EVENT**

Display items	Active power: Active power for each channel and sum value for multiple channels. Sink (consumption) and Source (regeneration) Apparent power: Apparent power of each channel and its sum for multiple channels No polarity Reactive power: Reactive power of each channel and its sum for multiple channels Lag phase (LAG: current lags voltage) and Lead phase (LEAD: current leads voltage)
Measurement method	Active power: Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz) Apparent power: Calculated from RMS voltage U and RMS current I Reactive power: Calculated using apparent power S and active power P
Sampling frequency	200kHz
Measurement range, resolution	Depends on the voltage × current range combination; see Input specifications
Measurement accuracy	Active power: ±0.2% rdg.±0.1%f.s. + clamp-on sensor accuracy Apparent power: ±1 dgt. for calculations derived from the various measurement values Reactive power: ±1 dgt. for calculations derived from the various measurement values

Active energy /Reactive energy**TIME PLOT**

Display items	Active energy: WP+ (consumption), WP- (regeneration); Sum of multiple channels Reactive energy: WQLAG (lag), WQLEAD (lead); Sum for multiple channels Elapsed time
Measurement method	Measured every 10 cycles (50 Hz) or 12 cycles (60 Hz) Integrated separately by consumption and regeneration from active power Integrated separately by lag and lead from reactive power Integration starts at the same time as recording Recorded at the specified TIMEPLOT interval
Sampling frequency	200kHz
Measurement range, resolution	Depends on the voltage × current range combination; see Input specifications
Measurement accuracy	Active energy: Active power measurement accuracy ±10 dgt. Reactive energy: Reactive power measurement accuracy ±10 dgt. Cumulative time accuracy: ±10 ppm ±1s (23°C [73°F])

Power factor /Displacement power factor**TIME PLOT****EVENT**

Display items	Displacement power factor of each channel and its sum value for multiple channels
Measurement method	Power factor : Calculated from RMS voltage U, RMS current I, and active power P Displacement power factor : Calculated from the phase difference between the fundamental voltage wave and the fundamental current wave Lag phase (LAG: current lags voltage) and Lead phase (LEAD: current leads voltage)
Sampling frequency	200kHz
Measurement range, resolution	-1.0000 (lead) to 0.0000 to 1.0000 (lag)

Voltage unbalance factor/ Current unbalance factor (negative-phase, zero-phase)**TIME PLOT**

Display items	Voltage unbalance factor : Negative-phase unbalance factor, zero-phase unbalance factor Current unbalance factor : Negative-phase unbalance factor, zero-phase unbalance factor
Measurement method	Calculated using various components of the three-phase fundamental wave (line-to-line voltage) for three-phase 3-wire (3P3W2M, 3P3W3M) and three-phase 4-wire connections
Sampling frequency	200kHz
Measurement range	Voltage unbalance factor : Component is V and unbalance factor is 0.00% to 100.00% Current unbalance factor : Component is A and unbalance factor is 0.00% to 100.00%
Measurement accuracy	Voltage unbalance factor : ±0.15% Current unbalance factor : —

High-order harmonic voltage component/ High-order harmonic current component**HIGH-ORDER HARM****TIME PLOT****EVENT**

Display items	For single incidents and continuous transient incidents High-order harmonic voltage component value High-order harmonic current component value For continuous incidents High-order harmonic voltage component maximum value High-order harmonic current component maximum value High-order harmonic voltage component period High-order harmonic current component period
Measurement method	The waveform obtained by eliminating the fundamental component is calculated using the true RMS method during 10 cycles (50 Hz) or 12 cycles (60 Hz) of the fundamental wave
Sampling frequency	200kHz
Measurement range, resolution	High-order harmonic voltage component : 600.00V, 0.01V High-order harmonic current component : Based on clamp-on sensor in use; See Input specifications
Measurement bandwidth	2kHz (-3dB) to 80kHz (-3dB)
Measurement accuracy	High-order harmonic voltage component : ±10%rdg. ±0.1%f.s. High-order harmonic current component : ±10% rdg.±0.2%f.s. + clamp-on sensor accuracy

Harmonic voltage/ Harmonic current (including fundamental component)**TIME PLOT****EVENT**

Display items	Select either RMS or content percentage; From 0 to 50th order
Measurement method	Uses IEC61000-4-7:2002.
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)
No. of window points	4096 points synchronized with harmonic calculations
Measurement range, resolution	Harmonic voltage : 600.00V, 0.01V Harmonic current : Based on clamp-on sensor in use; see Input specifications
Measurement accuracy	See measurement accuracy with a fundamental wave of 50/60 Hz When using an AC-only clamp sensor, 0th order is not specified for current and power

Total harmonic voltage/ Total harmonic current distortion factor		TIME PLOT	EVENT
Display items	THD-F (total harmonic distortion factor for the fundamental wave) THD-R (total harmonic distortion factor for the total harmonic including the fundamental wave)		
Measurement method	Based on IEC61000-4-7:2002; Max. order: 50th		
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)		
No. of window points	4096 points synchronized with harmonic calculations		
Measurement range, resolution	0.00 to 100.00%(Voltage), 0.00 to 500.00%(Current)		
Measurement accuracy	—		

Harmonic power (including fundamental component)		TIME PLOT	EVENT
Display item	Select either RMS or content percentage; From 0 to 50th order		
Measurement method	Uses IEC61000-4-7:2002.		
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)		
No. of window points	4096 points synchronized with harmonic calculations		
Measurement range, resolution	Depends on the voltage × current range combination; See Input specifications		
Measurement accuracy	See measurement accuracy with a fundamental wave of 50/60 Hz (When using an AC-only clamp sensor, order 0 is not specified for current and power)		

Measurement accuracy with a fundamental wave of 50/60 Hz	
Harmonic input	Measurement accuracy
Voltage (At least 1% of nominal voltage)	Specified with a nominal voltage of at least 100 V Order 0: ±0.3%rdg.±0.08%f.s. Order 1+: ±5.00%rdg
Voltage (<1% of nominal voltage)	Specified with a nominal voltage of at least 100 V Order 0: ±0.3%rdg.±0.08%f.s. Order 1+: ±0.05% of nominal voltage
Current	Order 0: ±0.5%rdg.±0.5%f.s. +clamp-on sensor accuracy Order 1 to 20th: ±0.5%rdg.±0.2%f.s. +clamp-on sensor accuracy Order 21 to 50th: ±1.0%rdg.±0.3%f.s. +clamp-on sensor accuracy
Power	Order 0: ±0.5%rdg.±0.5%f.s. +clamp-on sensor accuracy Order 1 to 20th: ±0.5%rdg.±0.2%f.s. +clamp-on sensor accuracy Order 21 to 30th: ±1.0%rdg.±0.3%f.s. +clamp-on sensor accuracy Order 31 to 40th: ±2.0%rdg.±0.3%f.s. +clamp-on sensor accuracy Order 41 to 50th: ±3.0%rdg.±0.3%f.s. +clamp-on sensor accuracy

Harmonic voltage phase angle/ Harmonic current phase angle (including fundamental component)		TIME PLOT
Display item	Harmonic phase angle components for whole orders	
Measurement method	Uses IEC61000-4-7:2002.	
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)	
No. of window points	4096 points synchronized with harmonic calculations	
Measurement range, resolution	-180.00° to 0.00° to 180.00°	
Measurement accuracy	—	

Harmonic voltage-current phase angle (including fundamental component)		TIME PLOT	EVENT
Display item	Indicates the difference between the harmonic voltage phase angle and the harmonic current phase angle. Harmonic voltage-current phase difference for each channel and sum (total) value for multiple channels		
Measurement method	Uses IEC61000-4-7:2002.		
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)		
No. of window points	4096 points synchronized with harmonic calculations		
Measurement range, resolution	-180.00° to 0.00° to 180.00°		
Measurement accuracy	1st to 3rd orders : ± 2° +clamp-on sensor accuracy 4th to 50th orders: ±(0.05° × k+2°) +clamp-on sensor accuracy; (k: harmonic orders) Specified with a harmonic voltage of 1 V for each order and a current level of at 1% f.s. or greater.		

Inter-harmonic voltage and inter-harmonic current		TIME PLOT
Display item	Select either RMS or content percentage; 0.5 to 49.5th orders	
Measurement method	Uses IEC61000-4-7:2002.	
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)	
No. of window points	4096 points synchronized with harmonic calculations	
Measurement range, resolution	Inter-harmonic voltage : 600.00V, 0.01V Inter-harmonic current : Due to using clamp-on sensor; See Input specifications	
Measurement accuracy	Inter-harmonic voltage (Specified with a nominal voltage of at least 100 V) : At least 1% of harmonic input nominal voltage : ±5.00% rdg. <1% of harmonic input nominal voltage : ±0.05% of nominal voltage Inter-harmonic current : Unspecified	

K Factor (multiplication factor)		TIME PLOT	EVENT
Measurement method	Calculated using the harmonic RMS current of the 2nd to 50th orders		
Comparison window width	10 cycles (50 Hz), 12 cycles (60 Hz)		
No. of window points	4096 points synchronized with harmonic calculations		
Measurement range, resolution	0.00 to 500.00		
Measurement accuracy	—		

Instantaneous flicker value		TIME PLOT
Measurement method	As per IEC61000-4-15 User-selectable from 230 Vlamp/120 Vlamp (when Pst and Plt are selected for flicker measurement)/4 types of Ed2 filter (230 Vlamp 50/60 Hz, 120 Vlamp 60/50 Hz)	
Measurement range, resolution	99.999, 0.001	

Δ V10 Flicker		TIME PLOT
Display items	ΔV10 measured at one minute intervals, average value for one hour, maximum value for one hour, fourth largest value for one hour, total (within the measurement interval) maximum value	
Measurement method	Calculated values are subject to 100 V conversion following gap-less measurement once each minute	
Measurement range, resolution	0.000 to 99.999V	
Measurement accuracy	±2% rdg.±0.01 V (with a fundamental wave of 100 Vrms [50/60 Hz], a fluctuation voltage of 1 Vrms, and a fluctuation frequency of 10 Hz)	
Threshold	0.00 to 9.99V alarm output is generated when the reading for each minute is compared to the threshold and found to be greater	

IEC Flicker		TIME PLOT
Display items	Short interval flicker Pst, long interval flicker Plt	
Measurement method	Based on IEC61000-4-15:1997 +A1:2003 Ed1/Ed2. Pst is calculated after 10 minutes of continuous measurement and Plt after 2 hours of continuous measurement	
Measurement range	0.0001 to 10000 P.U. broken into 1,024 segments with a logarithm	
Measurement accuracy	Pst ±5% rdg. (Specified within range 0.1000 to 20.000 using IEC61000-4-15 Ed1.1 and IEC61000-4-15 Ed2 Class F1 performance test.)	
Flicker filter	Select 230 V lamp Ed1, 120 V lamp Ed1, 230 V lamp Ed2, or 120 V lamp Ed2.	

Clamp-on sensors specifications (Options)

Clamp-on sensor	CLAMP ON SENSOR 9694	CLAMP ON SENSOR 9660	CLAMP ON SENSOR 9661
Appearance			
Primary current rating	5A AC	100A AC	500A AC
Output voltage	10mV/A AC	AC 1mV/A AC	AC 1mV/A AC
Measurement range	See input specifications		
Amplitude accuracy *	$\pm 0.3\% \text{rdg.} \pm 0.02\% \text{f.s.} *$	$\pm 0.3\% \text{rdg.} \pm 0.02\% \text{f.s.} *$	$\pm 0.3\% \text{rdg.} \pm 0.01\% \text{f.s.} *$
Phase accuracy *	$\pm 2^\circ$ or less *	$\pm 1^\circ$ or less *	$\pm 0.5^\circ$ or less *
Maximum allowable input *	50 A continuous *	130 A continuous *	550 A continuous *
Maximum rated voltage to earth	CAT III 300Vrms		CAT III 600 Vrms
Frequency characteristics	$\pm 1.0\%$ or less for 66Hz to 5kHz (deviation from specified accuracy)		
Cord length	3m (9.84ft)		
Measurable conductor diameter	Max. $\phi 15\text{mm}$ (0.59")		Max. $\phi 46\text{mm}$ (1.81")
Dimensions, Mass	46W(1.81") \times 135H(5.31") \times 21D(0.83")mm, 230g(8.1oz.)		78W(3.07") \times 152H(5.98") \times 42D(1.65")mm, 380g(13.4oz.)
* : 45 to 66Hz			

Clamp-on sensor	CLAMP ON SENSOR 9669	CLAMP ON SENSOR 9695-02	CLAMP ON SENSOR 9695-03
Appearance		 Insulated conductor Not CE marked	 Insulated conductor Not CE marked
Primary current rating	1000 A AC	50A AC	100A AC
Output voltage	0.5mV/A AC	10mV/A AC	1mV/A AC
Measurement range	See input specifications		
Amplitude accuracy *	$\pm 1.0\% \text{rdg.} \pm 0.01\% \text{f.s.} *$	$\pm 0.3\% \text{rdg.} \pm 0.02\% \text{f.s.} *$	$\pm 0.3\% \text{rdg.} \pm 0.02\% \text{f.s.} *$
Phase accuracy *	$\pm 1^\circ$ or less *	Within $\pm 2^\circ$ *	Within $\pm 1^\circ$ *
Maximum allowable input *	1000 A continuous *	130 A continuous *	130 A continuous *
Maximum rated voltage to earth	CATIII 600Vrms	CATIII 300Vrms	
Frequency characteristics	Within $\pm 2\%$ at 40Hz to 5kHz (deviation from accuracy)	Within $\pm 2\%$ at 40Hz to 5kHz (deviation from accuracy)	
Cord length	3m (9.84ft)	CONNECTION CORD 9219 (sold separately) is required.	
Measurable conductor diameter	Max. $\phi 55\text{mm}$ (2.17"), 80 (3.15") \times 20(0.79") mm busbar	Max. $\phi 15\text{mm}$ (0.59")	
Dimensions, Mass	99.5W (3.92") \times 188H (7.40") \times 42D (1.65") mm, 590g (20.8 oz.)	51W (2.01") \times 58H (2.28") \times 19D (0.75") mm, 50g (1.8oz.)	
Options (sold separately)	—	CONNECTION CORD 9219 (Cord length: 3m (9.84ft))	
* : 45 to 66Hz			



CONNECTION CORD 9219

Clamp-on sensor	AC FLEXIBLE CURRENT SENSOR CT9667-01	AC FLEXIBLE CURRENT SENSOR CT9667-02	AC FLEXIBLE CURRENT SENSOR CT9667-03
Appearance			
Primary current rating	500A AC, 5000A AC (selectable)		
Output voltage	500 mV AC f.s.		
Measurement range	See input specifications		
Amplitude accuracy *	$\pm 2.0\% \text{rdg.} \pm 0.3\% \text{f.s.} *$		
Phase accuracy *	$\pm 1^\circ$ or less *		
Maximum allowable input *	10000 A continuous *		
Maximum rated voltage to earth	CATIII 1000 Vrms CATIV 600 Vrms		
Frequency characteristics	$\pm 3\text{dB}$ or less for 10 Hz to 20kHz (within $\pm 3\text{dB}$)		
Cord length	Sensor to circuit: 2m (6.56ft), Circuit to connector: 1m (3.28ft)		
Measurable conductor diameter	Max. $\phi 100\text{mm}$ (3.94")	Max. $\phi 180\text{mm}$ (7.09")	Max. $\phi 254\text{mm}$ (10.0")
Dimensions, Mass	Circuit box: 35W (1.38") \times 120.5H (4.74") \times 34D (1.34") mm		
Mass	280g (9.9 oz.)	Sensor cable diameter: $\phi 7.4\text{mm}$ (0.29")	Sensor cable diameter: $\phi 13\text{mm}$ (0.51")
Power supply	LR6 alkaline battery x2, AC Adapter (option), or external 5 to 15 V DC power supply		
Options (sold separately)	AC ADAPTER 9445-02 (universal 100 to 240VAC, 9V/1A output/for USA) AC ADAPTER 9445-03 (universal 100 to 240VAC, 9V/1A output/for Europe)		
* : 45 to 66Hz			

Clamp-on sensor	AC/DC AUTO-ZERO CURRENT SENSOR CT7731	AC/DC AUTO-ZERO CURRENT SENSOR CT7736	AC/DC AUTO-ZERO CURRENT SENSOR CT7742
Appearance			
Primary current rating	100A AC/DC	600A AC/DC	2000A AC/DC
Output voltage (The range is switched using the Display Unit CM7290.)	60A range : 10mV/A 100A range : 1mV/A	60A range : 10mV/A 600A range : 1mV/A	600A range : 1mV/A 2000A range : 0.1mV/A
Amplitude accuracy *	±1.0%rdg. ±0.5%f.s. *	±2.0%rdg. ±0.5%f.s. *	±1.5%rdg. ±0.5%f.s. *
Phase accuracy **	±1.8° or less	±1.8° or less	±2.3° or less
Maximum allowable input **	100 A continuous	600 A continuous	2000 A continuous
Maximum rated voltage to earth	CATIV AC/DC 600Vrms	CATIII AC/DC 1000Vrms / CATIV AC/DC 600Vrms	
Frequency characteristics	DC to 5kHz (-3dB)		
Cord length	2.5m (8.20ft)		
Measurable conductor diameter	Max.φ33mm (1.30")	Max.φ33mm (1.30")	Max.φ55mm (2.17")
Dimensions, Mass	58W(2.28")×132H(5.20")×18D(0.71")mm, 250g(8.8oz.)	64W(2.52")×160H(6.30")×34D(1.34")mm, 320g(11.3oz.)	64W(2.52")×195H(7.68")×34D(1.34")mm, 510g(18.0oz.)
Power supply	DISPLAY UNIT CM7290		
*The Display Unit CM7290, Output Cord L9095, and AC Adapter 9445-02 or 9445-03 are required in order to use the AC/DC Auto-zero Current Sensor CT7700 series.			



* : DC, 45 to 66Hz ** : to 66Hz

Clamp-on leak sensor	CLAMP ON LEAK SENSOR 9657-10	CLAMP ON LEAK SENSOR 9675
Appearance		
Primary current rating	10A AC (Up to 5A on Model PW3198)	
Output voltage	100 mV/A AC	
Measurement range	See input specifications (Cannot be used to measure power)	
Amplitude accuracy *	±1.0%rdg.±0.05%f.s. *	±1.0%rdg.±0.005%f.s. *
Residual current characteristics	Max. 5mA (in 100A go and return electric wire)	Max. 1mA (in 10A go and return electric wire)
Effect of external magnetic fields	400A AC/m corresponds to 5mA, Max. 7.5mA	
Measurable conductor	Insulated conductor	
Cord length	3m (9.84ft)	
Measurable conductor diameter	Max. φ40 mm(1.57")	Max. φ30 mm(1.18oz")
Dimensions, Mass	74W(2.91")×145H(5.71")× 42D(1.65)mm, 380g(13.4oz.)	60W(2.36")×112.5H(4.43")× 23.6D(23.6")mm, 160g(5.6oz.)
* : 45 to 66Hz		

Options

Current measurement (see P.14 -15 Clamp-on sensors specifications for details)

CLAMP ON SENSOR (Load current, AC)



9694
5A AC,
φ15mm(0.59")



9660
100A AC,
φ15mm(0.59")



9661
500A AC,
φ46mm(1.81")



9669
1000A AC, φ55mm(2.17"),
80(3.15")x20(0.79")mm busbar



CT9667-01
500A AC/ 5000A AC
φ100mm (3.94"),
Power supply: LR06 alkaline battery
or AC ADAPTER 9445-02/03 (sold separately)



CT9667-02
500A AC/ 5000A AC
φ180mm (7.09"),
Power supply: LR06 alkaline battery
or AC ADAPTER 9445-02/03 (sold separately)



CT9667-03
500A AC/ 5000A AC
φ254mm (10"),
Power supply: LR06 alkaline battery
or AC ADAPTER 9445-02/03 (sold separately)

AC/DC AUTO-ZERO CURRENT SENSOR (Load current, AC/DC)



CT7731
100A AC/DC,
φ33mm(1.30")



CT7736
600A AC/DC,
φ33mm(1.30")



CT7742
2000A AC/DC,
φ55mm(2.17")

*The AC/DC Auto-zero Current Sensor CT7731/CT7736/CT7742 cannot be used on its own with the PW3198. Be sure to use a set that includes the Display Unit CM7290, Output Cord L9095, and AC Adapter 9445-02 or 9445-03.



DISPLAY UNIT CM7290
For use with the CT7700 series



OUTPUT CORD L9095
For use with BNC connectors, 1.5m (4.92ft)length



AC ADAPTER 9445-02
For USA,
100 to 240V AC, 9V/1A



AC ADAPTER 9445-03
For EU,
100 to 240 V AC, 9 V/ 1 A

CLAMP ON ADAPTER



9695-02 (50A AC)
9695-03 (100A AC)
φ15mm(0.59"), CONNECTION CORD 9219 is required (sold separately)



CONNECTION CORD 9219
For connecting 9695-02,9695-03
Cord length : 3m(9.84ft)



9290-10
CT ratio 10:1, AC1000A,
φ55mm(2.17"),
80(3.15")x20(0.79")mm busbar,
Cord length : 3m(9.84ft)

CLAMP ON LEAK SENSOR (Leak Current)
Cannot be used to measure power



9657-10
10A AC (Up to 5A on Model PW3198),
φ40mm(1.57")



9675
10A AC(Up to 5A on Model PW3198),
φ30mm(1.18")

Voltage measurement

WIRING ADAPTER PW9000
For 3P3W WIRING



WIRING ADAPTER PW9001
For 3P4W WIRING



MAGNETIC ADAPTER 9804-01 (red)
MAGNETIC ADAPTER 9804-02 (black)
Magnetic tip for use with the standard Voltage Cord L1000 (generally compatible with M6 pan screws)




Red and black adapters sold separately. Purchase the quantity and color appropriate for your application. (Example: 3P3W - 3 adapters; 3P4W - 4 adapters)

GRABBER CLIP 9243
For use with the standard Voltage Cord L1000



Reduce voltage cords for easy wiring

Application software

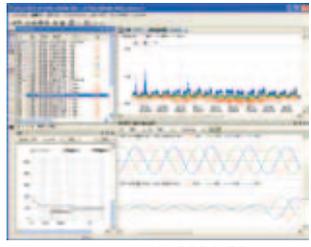

PQA-HiVIEW PRO 9624-50
Use Model 9624-50 PQA-HiVIEW PRO (version 2.00 or later) with a PC to analyze the data collected by the PW3198.

Case



CARRYING CASE C1001
Soft case
450Wx 345Wx 210Dmm
(17.7"Wx 13.6"Hx 8.3"D)
3.4kg (120oz.)



CARRYING CASE C1002
Hard case
413Wx 595Wx 265Dmm
(16.3"Wx 23.4"Hx 10.4"D)
5.7kg (201oz.)

Storage media



SD MEMORY CARD 8GB Z4003 *

Clock synchronization



GPS BOX PW9005
To synchronize the PW3198 clock,
Accessory: Connection cable set

Model Name: POWER QUALITY ANALYZER PW3198



Model No. (Order Code)

Bundled accessories
SD MEMORY CARD 2GB Z4001
Voltage cord L1000
AC adapter Z1002
Battery pack Z1003
Instruction manual
Measurement guide
Strap
USB cable (Approx. 1m in length)

(Specifications)

PW3198-90	Set of PW3198 and PQA HiVIEW PRO 9624-50
PW3198	Main Unit only

IMPORTANT

Use Model PQA-HiVIEW PRO 9624-50 (version 2.00 or later) with a PC to analyze the data collected by the PW3198.

Bundled accessories



Voltage Cord L1000
8 cords, approx. 3 m each:
1 each red, yellow, blue, and gray plus 4 black;
8 alligator clips: 1 each red, yellow, blue, and gray plus 4 black



AC ADAPTER Z1002
Power supply for the PW3198
100V AC to 240V AC



SD MEMORY CARD 2GB Z4001 *
*** IMPORTANT**
Use only HIOKI-approved SD memory cards



BATTERY PACK Z1003
(Ni-MH, 7.2 V/4500 mAh)

●Combination example: For three-phase 4-wire circuits containing leak current

PW3198-90	+	9661 × 3	+	9675	+	PW9001	+	C1001
POWER QUALITY ANALYZER PW3198 set with PQA HiVIEW PRO 9624-50		CLAMP ON SENSOR (500A)		CLAMP ON LEAK SENSOR		WIRING ADAPTER		CARRYING CASE

Note: Company names and Product names appearing in this catalog are trademarks or registered trademarks of various companies.

HIOKI

HIOKI E. E. CORPORATION

HEADQUARTERS
81 Koizumi
Ueda, Nagano 386-1192 Japan
www.hioki.com

HIOKI USA CORPORATION
TEL +1-609-409-9109 FAX +1-609-409-9108
hioki@hiokiusa.com / www.hiokiusa.com

HIOKI (Shanghai) SALES & TRADING CO., LTD.
TEL +86-21-6391-0090/0092 FAX +86-21-6391-0360
info@hioki.com.cn / www.hioki.cn

HIOKI SINGAPORE PTE. LTD.
TEL +65-6634-7677 FAX +65-6634-7477
info-sg@hioki.com.sg / www.hioki.com.sg

HIOKI KOREA CO., LTD.
TEL +82-2-2183-8847 FAX +82-2-2183-3360
info-kr@hioki.co.jp / www.hiokikorea.com

HIOKI EUROPE GmbH
TEL +49-6173-31856-0 FAX +49-6173-31856-25
hioki@hioki.eu / www.hioki.com

DISTRIBUTED BY